

FORM VI

BOILER INSPECTORATE DEPARTMENT

CERTIFICATE FOR USE OF A BOILER

(Regulation 389)

Registry Number of Boiler DNH 06

Type of Boiler. Horizontal Multitublar Shell
type smoke tube.

Boiler Rating 64 Sq.mts.

Place and year of manufacture Pune 2010.

Maximum continuous Evaporation 3000 Kg/Hr.

Name of Owner M/s. Dorf Ketal Chemicals (I) Pvt. Ltd.

Situation of Boiler Dadra, Silvassa.

Repairs -

Remarks Boiler to be operated by Qualified Boiler Attendant.

Hydraulically Tested on 08.08.2017 to 275 PSI lbs. per sq. inch.

I hereby certify that the above described boiler is permitted by me/the Chief Inspector under the provisions of Section 7/8 of the Indian Boilers Act No. V of 1923, to be worked at the maximum pressure of 150 PSI for period from 08.08.2017 to 07.08.2018.

The loading of the 2nos 25mm full lift safety valve is not to be exceed 150 PSI.

I further certify that the main steam-pipe was tested hydraulically to a pressure of 300 PSI last on 20.08.2010.

Fee Rs. 2700/-


Paid on: 27.07.2017.

Dated at Silvassa.

This 08.08.2017.

Inspector

Countersigned.

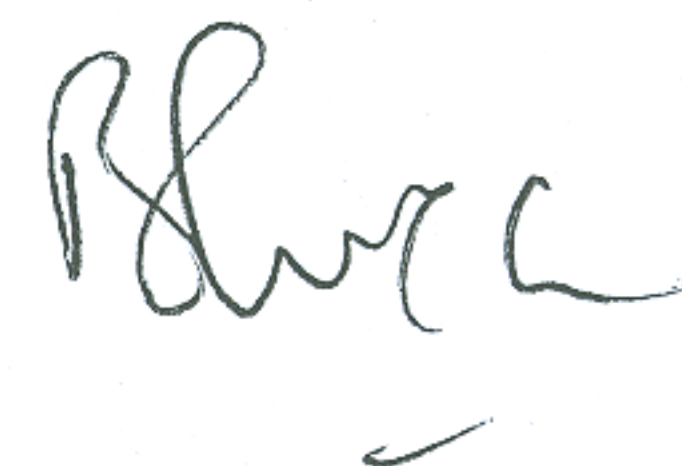

Chief Inspector of Boilers.

Chief Inspector of Boilers
Administration of Dadra & Nagar Haveli
SILVASSA